
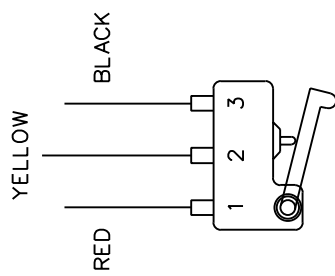


# ATCA Standard IPMC Power Control & Handle Switch

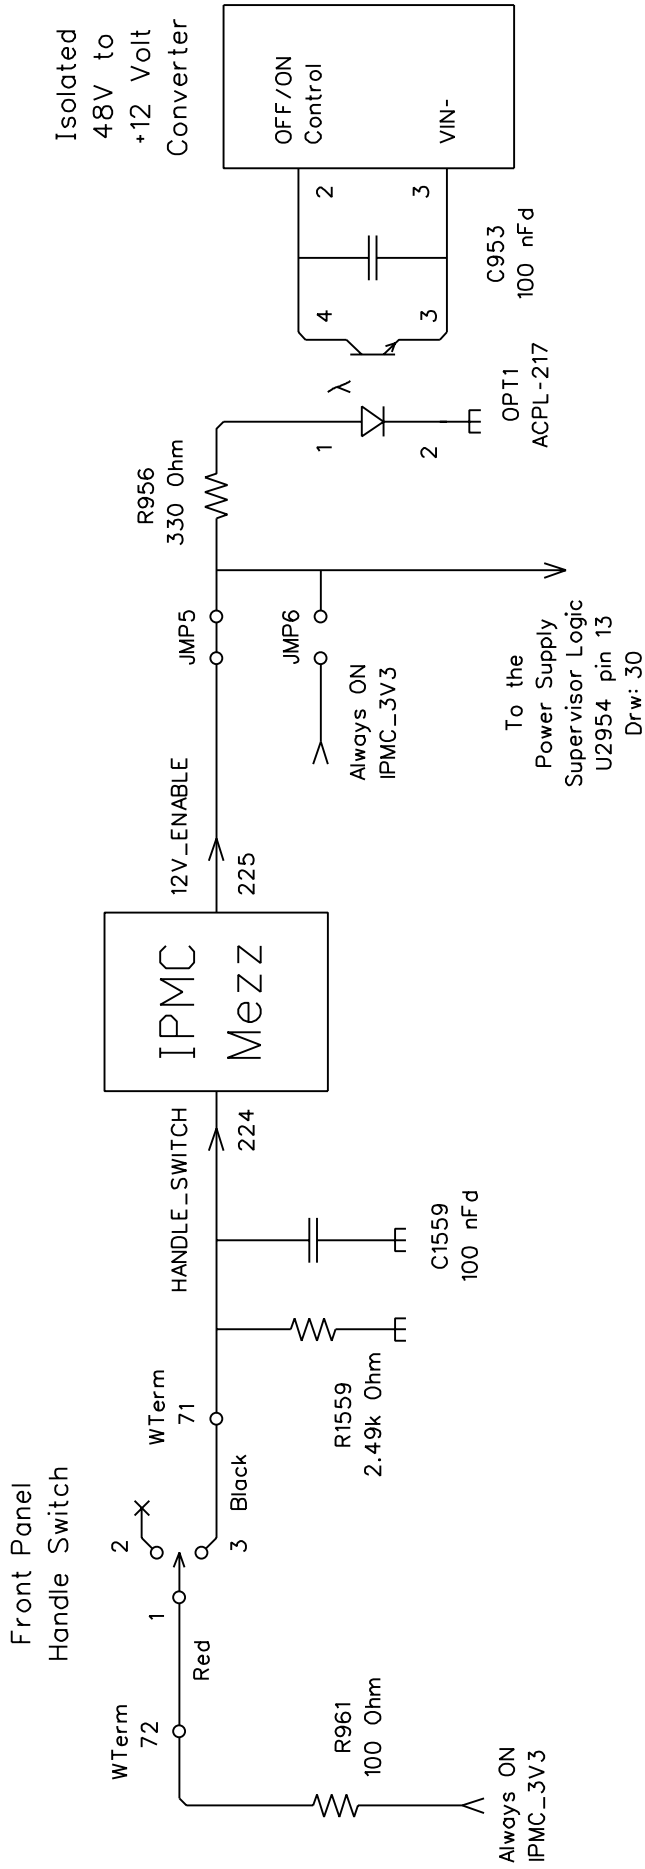

Handle Switch Contacts  
 1 - 3 Are Open &  
 1 - 2 Are Closed  
 Only When the Card is  
 Fully Inserted and the  
 Handle is Latched.

For Normal Standard ATCA Operation:

Switch Terminal\*2 and the Yellow Wire Are Not Used  
 Jumper JMP5 Is Installed  
 Jumper JMP6 Is Not Installed