


Hub  
Test  
Racks  
Pulizzi  
Control  
Loop  
 July 2019

PDU Control Loop  
 to Pulizzi Boxes →

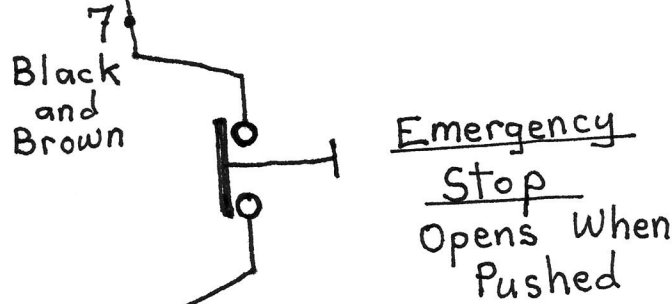

Emergency Stop  
 Opens When Pushed


Smoke Detector "Alarm"  
 Opens when Smoke is Detected

Water Detector  
 Closed Only When No Water on Floor


Temperature Limit  
 Closed Only When Temp. < Limit

Smoke Detector "Supervisor"  
 Closed Only when Smoke Detector is Powered Up and Operating

Control Switch  
 Closed Only in ON and Start Positions

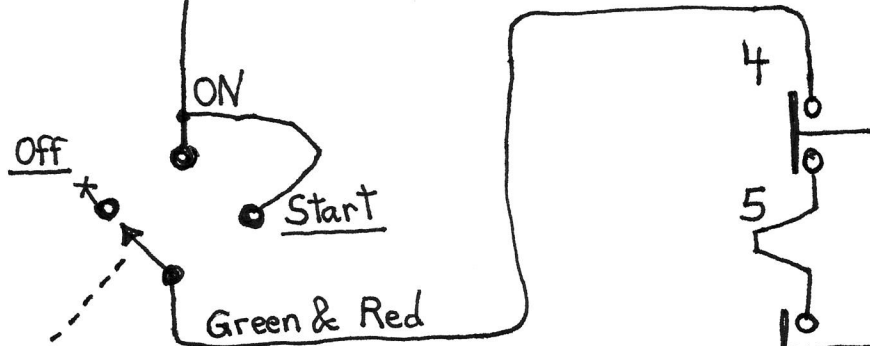

Control Switch  
 Closed Only in Start  
 Start is a Momentary Position

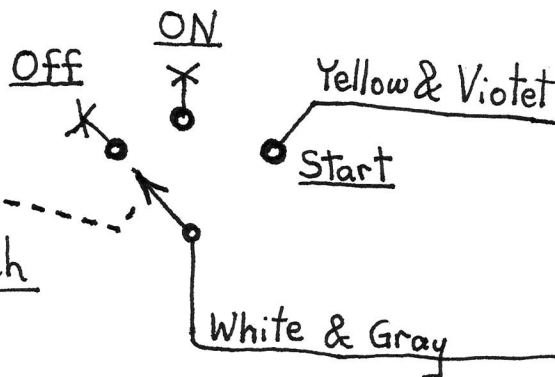

PDU Control Loop  
 to Pulizzi Boxes →

Closed ⇒ Circuit Conducts Electricity  
 Terminals 1 & 7 are used as Posts